

# Quality Assurance of the Production Process

This is to certify that:

Reacton Fire Suppression Ltd  
14 Baynes Place  
Chelmsford  
CM1 2QX  
United Kingdom

Holds Certificate Number:

CE 670083

In respect of:


## High Performance Automatic Fire Suppression Systems

On the basis of our examination under the requirements of Council Directive 2014/68/EU Module D1 of the Pressure Equipment Directive, as transposed into the law of The Netherlands Warenwetbesluit drukapparatuur 2016.

For and on behalf of BSI, a Notified  
Body for the above Directive  
(Notified Body Number 2797):

Previous Notified Body: BSI 0086

First Issued: 2017-09-05

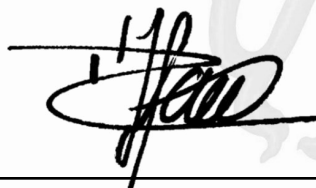

Drs. Dave Hagenaaars, Managing Director

Latest Issue: 2019-10-24

# Quality Assurance of the Production Process

No. CE 670083

## Additional Information


### Limitations of Certificate Validity

The design, manufacture, testing and inspection of automatic fire suppression systems up to and including Hazard Category II using CE certified cylinders with CE or SEP certified valves for use in fixed or mobile installations

PS  $\leq$  30 bar g

TS = -30°C to +60°C

Utilising the following extinguishants - HFC-227ea, FK-5-1-12, AFFF, Dry Powder, Class F Wet Chemical and Water

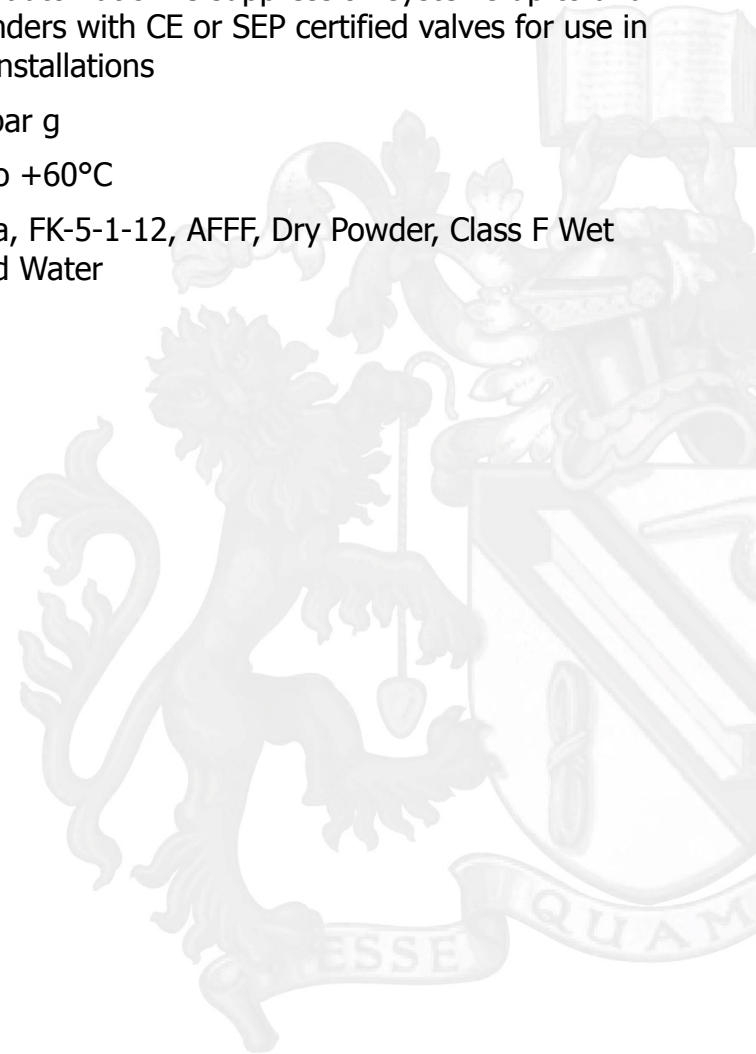

First Issued: 2017-09-05

Latest Issue: 2019-10-24

Page: 2 of 2

This certificate has been issued by and remains the property of BSI Group The Netherlands B.V., John M. Keynesplein 9, 1066 EP Amsterdam, The Netherlands and should be returned immediately upon request.  
To check its validity telephone +31 20 3460780. An electronic certificate can be authenticated [online](#).

BSI Group The Netherlands B.V., registered in the Netherlands under number 33264284, at John M. Keynesplein 9, 1066 EP Amsterdam, The Netherlands  
A member of BSI Group of Companies.